


# LWA Power Termination at Box B5

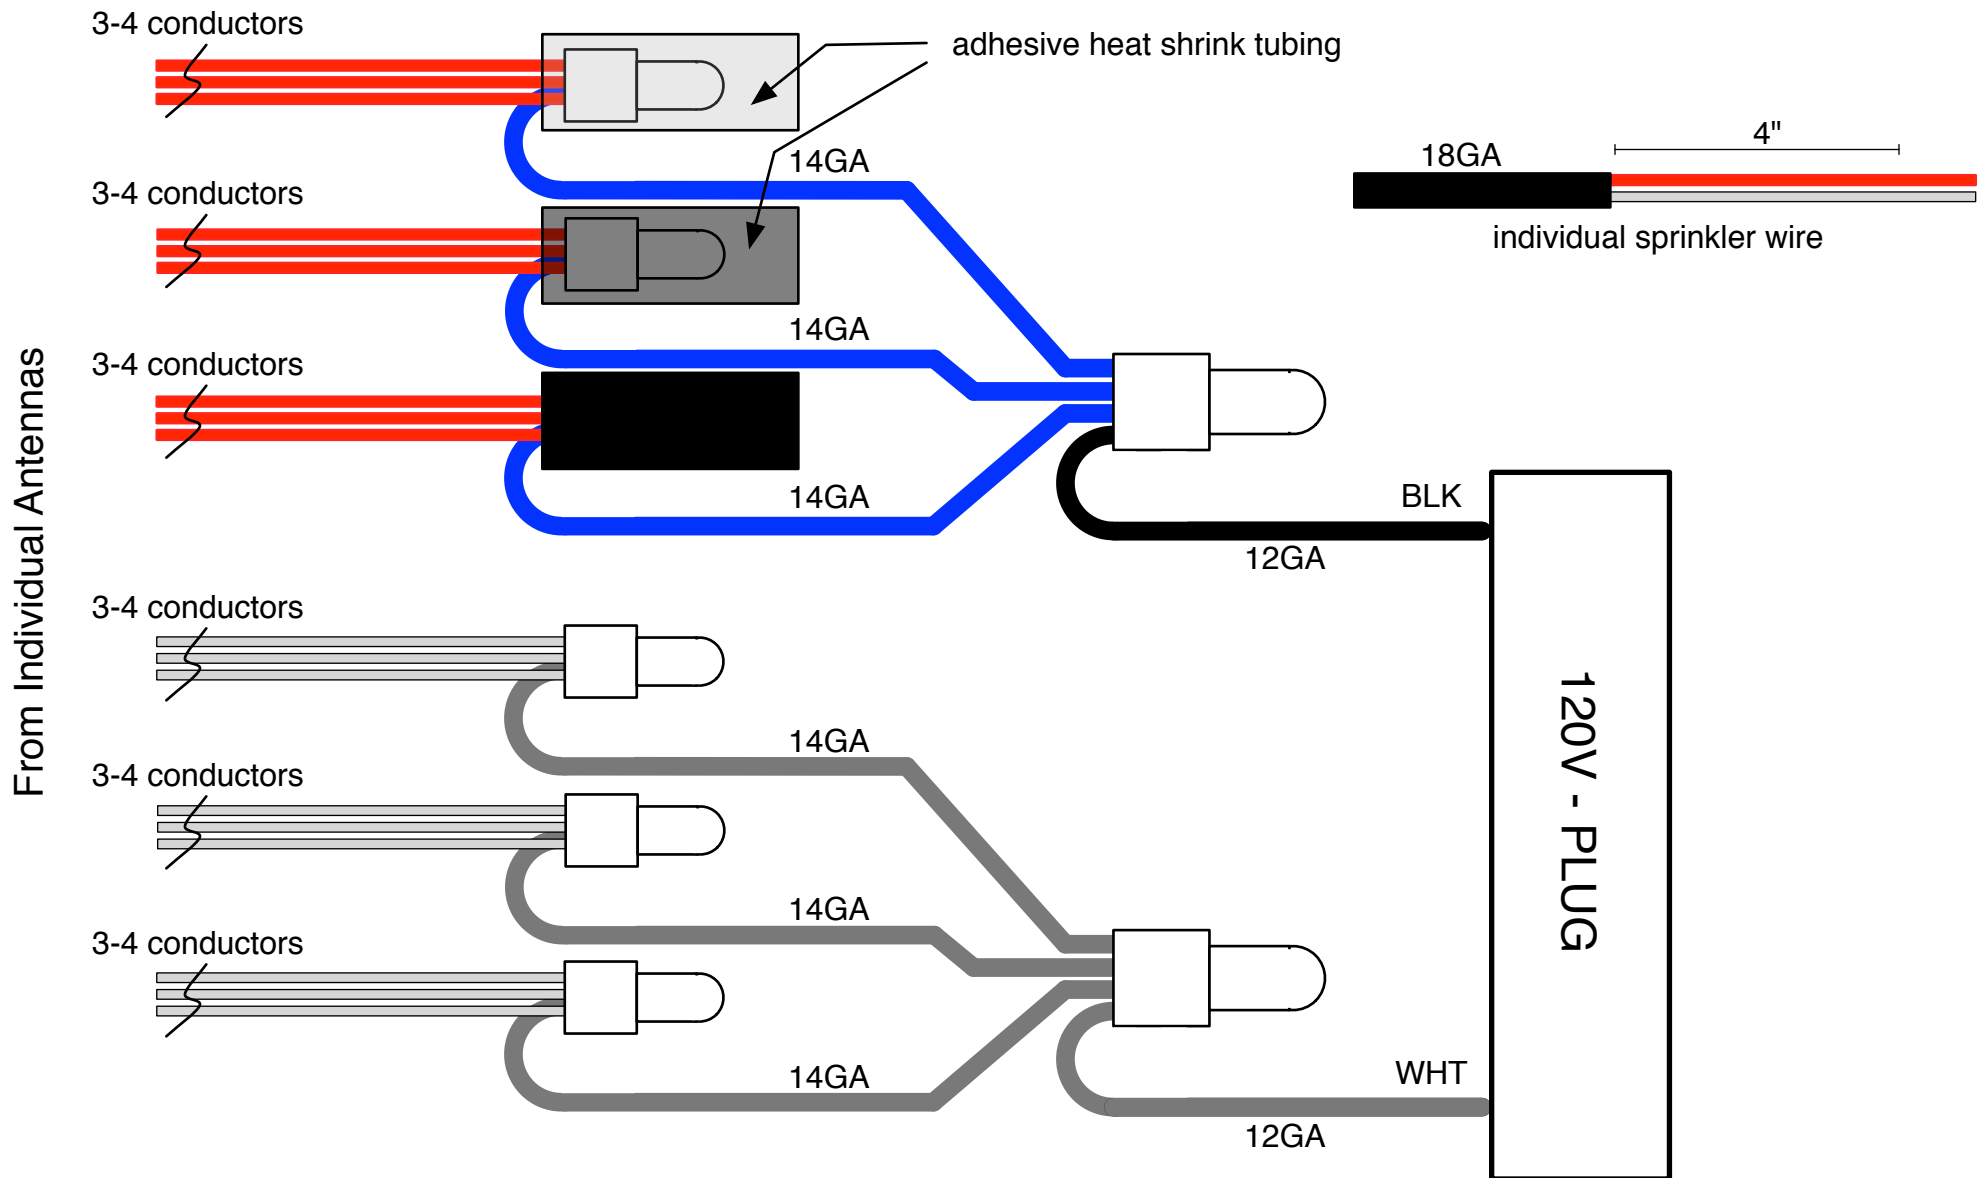

Typical 120VAC Branch Splice (West. North,East)